



GUARD POST INSTALLATION

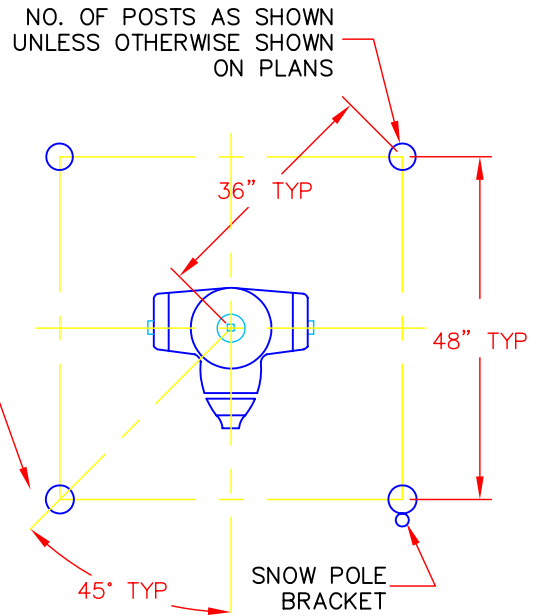

HYDRANT-POST SPACING

NOTE:
 SEE STD. SPEC. DETAILS :
 W-1 - FIRE HYDRANT
 W-3 - WATER VALVE & BOX
 W-11 - TRENCH SECTION
 W-12 - TRENCH SECTION

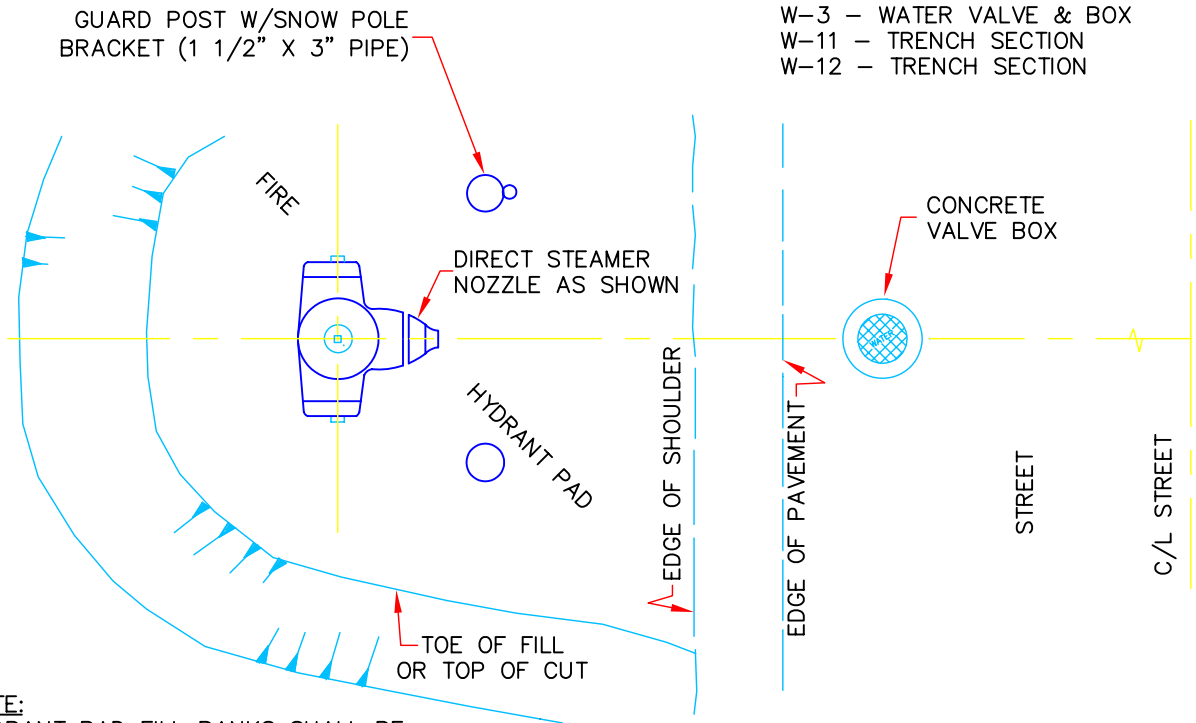

NOTE:
 HYDRANT PAD FILL BANKS SHALL BE CONSTRUCTED TO THE REQUIREMENTS FOR ROADWAY EMBANKMENT & SLOPE COMPACTION 95% MIN. SEE SPECS

HYDRANT PAD PLAN

**NORTHSTAR COMMUNITY SERVICES DISTRICT
 STANDARD SPECIFICATION
 HYDRANT GUARD POST AND PAD**

REVISIONS			DRAWN BY: EM
DATE	BY	APP'D	
			DATE: OCT 2006
			APPROVED BY: MG
			SCALE: N.T.S.
			SHEET: W-02